


- Notes
1. For planning purposes only.
 2. All dimensions in millimeters unless otherwise stated.
 3. The fence is to be constructed in accordance with B.S. 1722 Part 12.
 4. Galvanising to be in accordance with IS EN ISO 1461.
 5. Powder coating to be in accordance with IS EN ISO 13438.
 6. Pales to be triple pointed & splayed, and welded to rails in accordance with CL. 5.1 of BS 1722.
 7. Gap between pales and between pales and Rolled Steel Joist to be not greater than 50mm.
 8. Minimum height of fence on the either side of compound is to be 2600mm.
 9. In areas of made up ground, additional concrete to be used in base.
 10. Concrete to be Grade C20/25 to bases, C30/37 to plinths.

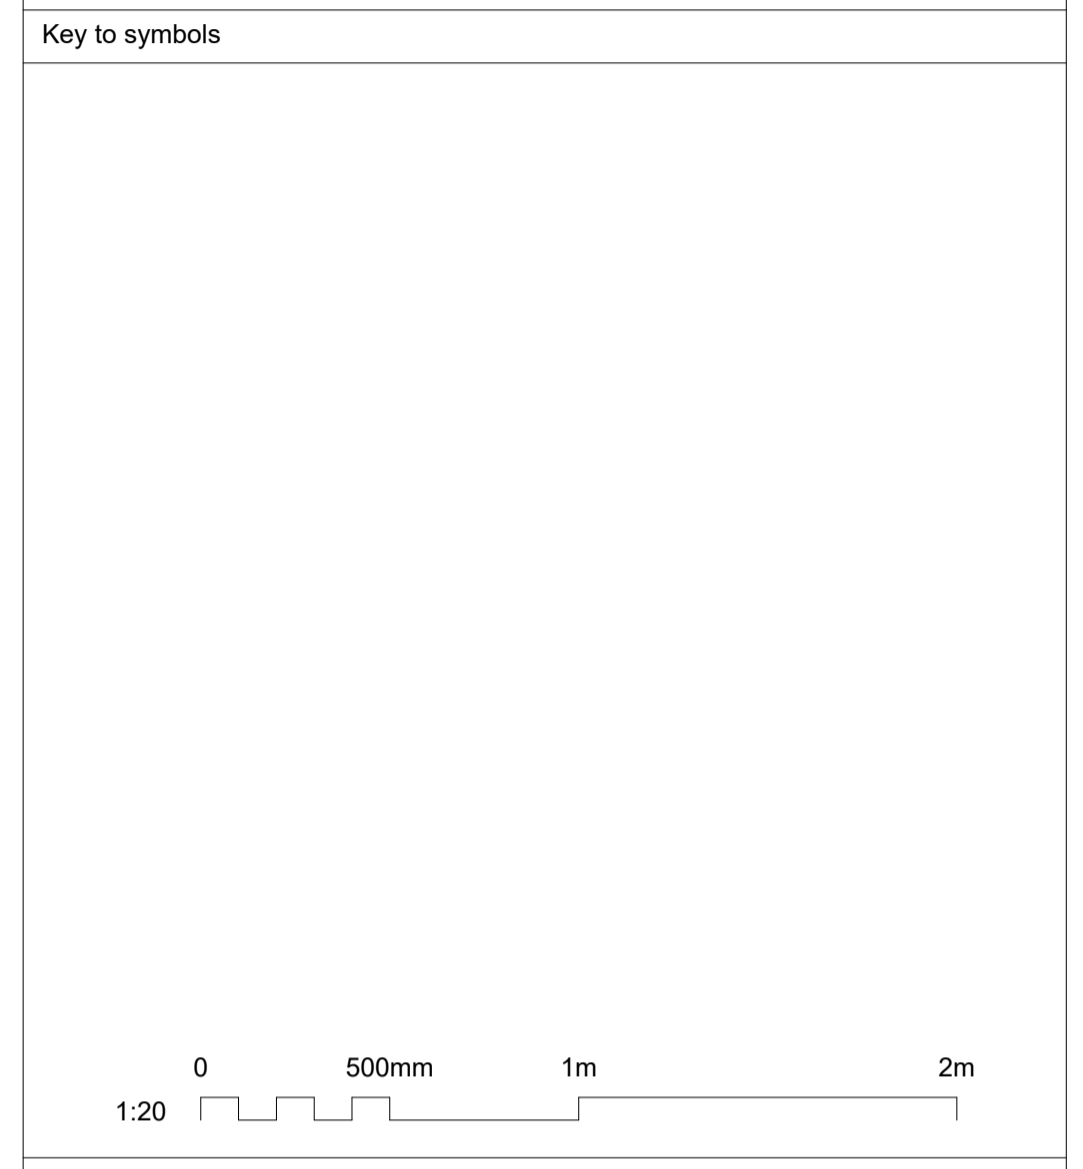

PL1	10.07.2020	CHC	Issued for Planning	DMcC	TK
Rev	Date	Drawn	Description	Ch'k'd	App'd

MOTT MACDONALD

South Block
 Rockfield
 Dundrum
 Dublin 16
 Ireland
 T +353 (0)1 291 6700
 F
 W www.mottmac.com



Title

**Capital Project 0970
 Cross Shannon 400 kV Cable Project
 Fence Section
 Detail**

Designed	B. Zulueta	Eng check	D. McCormack
Drawn	C. Cunningham	Coordination	E. Halpenny
Dwg check	D. Hassett	Approved	T. Keane
Scale at A1	Status	Rev	Security
1:20	PRE	PL1	STD
Drawing Number			
229379408-MMD-01-XX-DR-E-1231			